
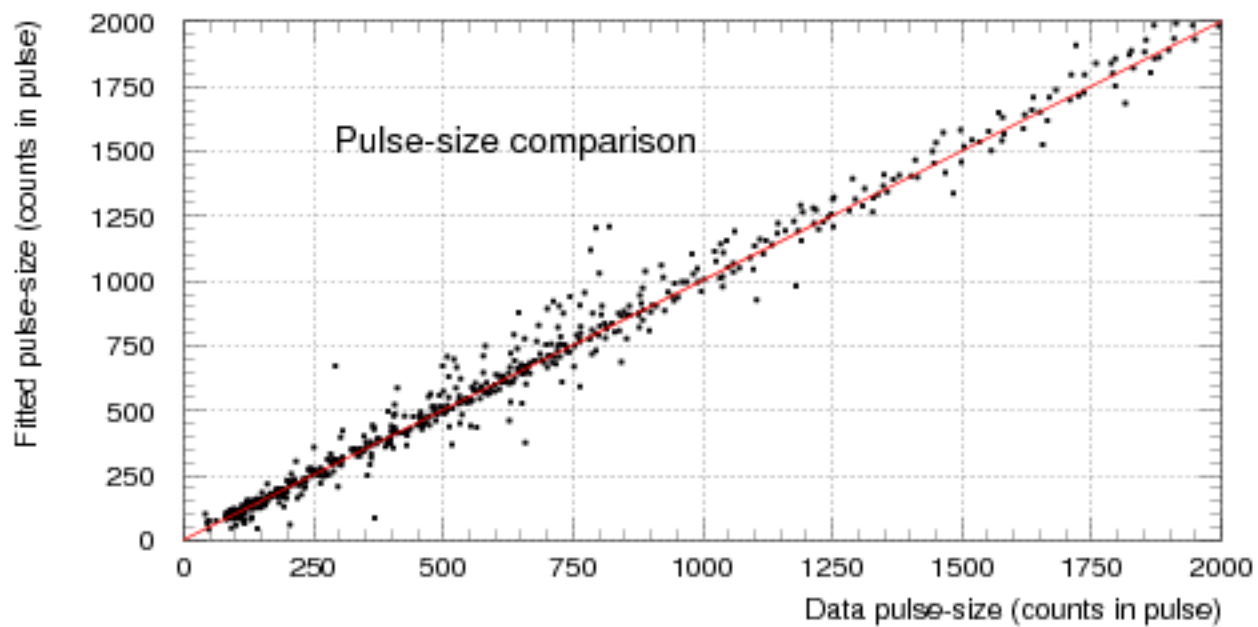





2025/10/05 18.19

MUV1: pulse MAX - MIN; Total Pulse-Size Fit vs Data

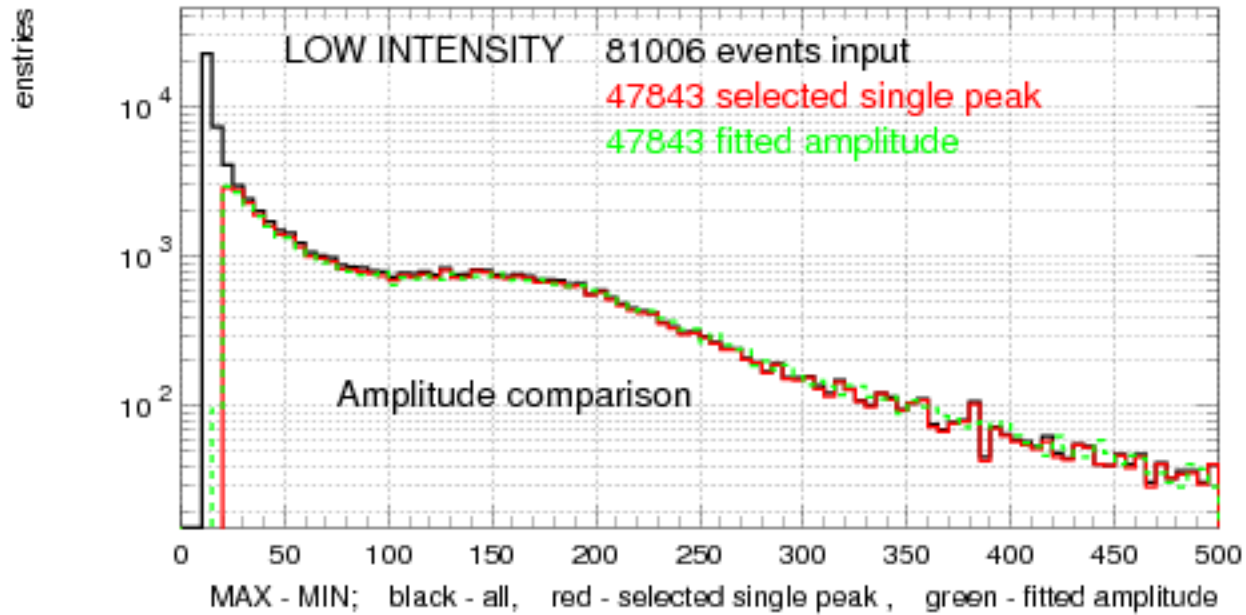





2025/10/05 18.19

MUV1: fit compared with raw data; size, amplitude

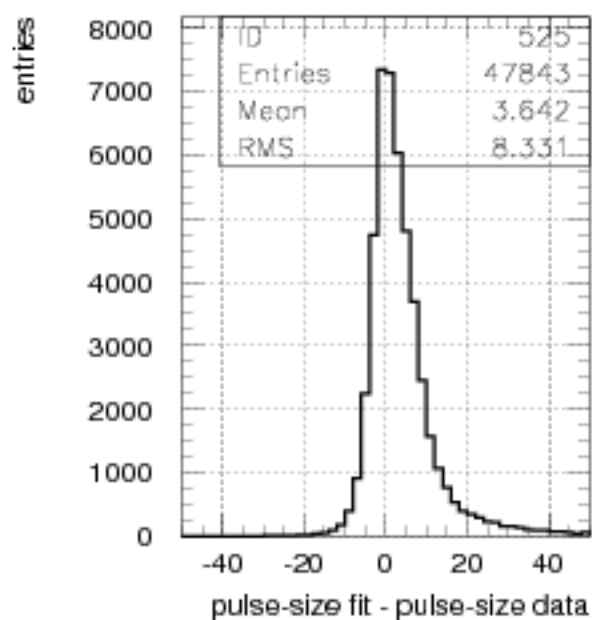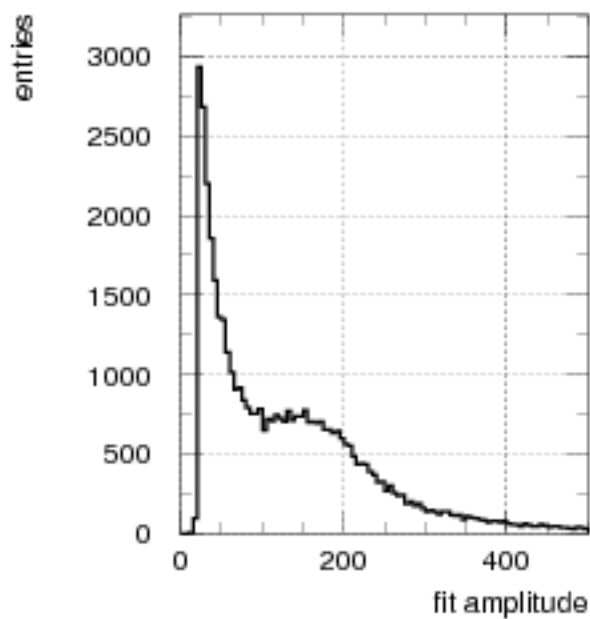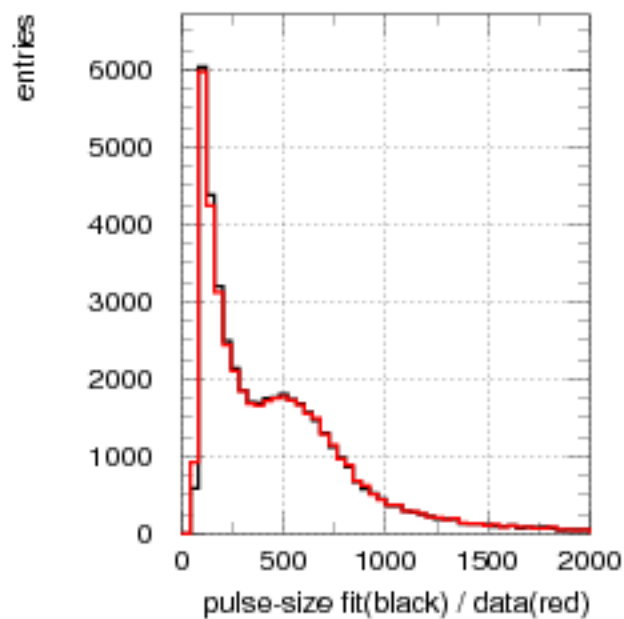



2025/10/05 18.19

MUV1: Compare split-normal fit with time and rms of pulse data

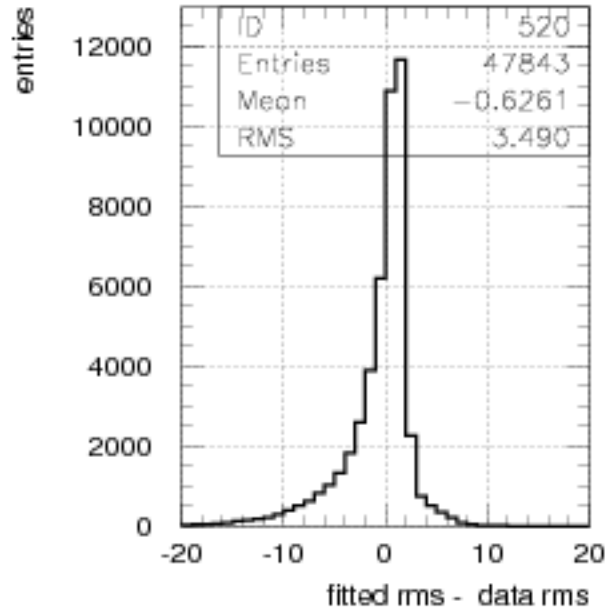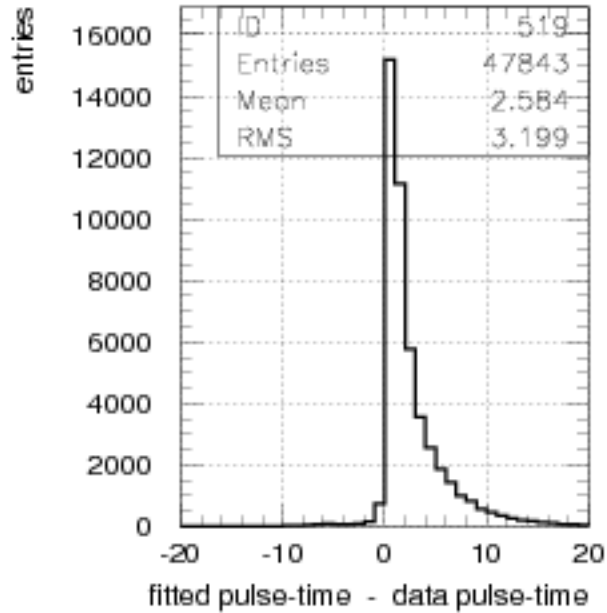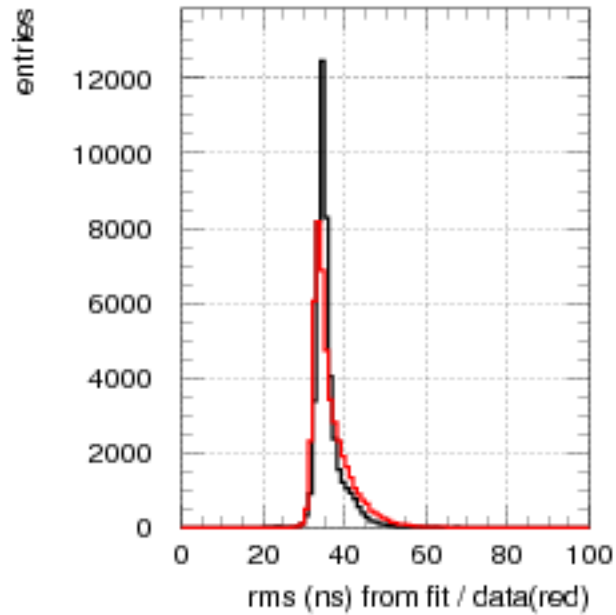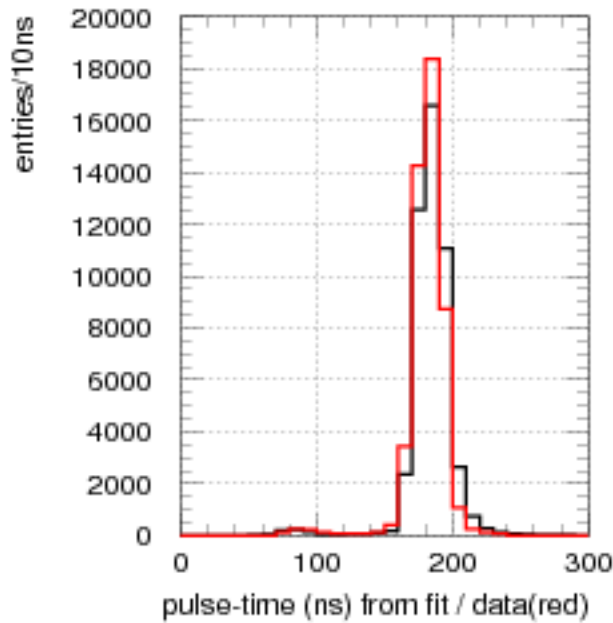


2025/10/05 18.19

fitted skewness(normalised), fitted sigma2 - sigma1

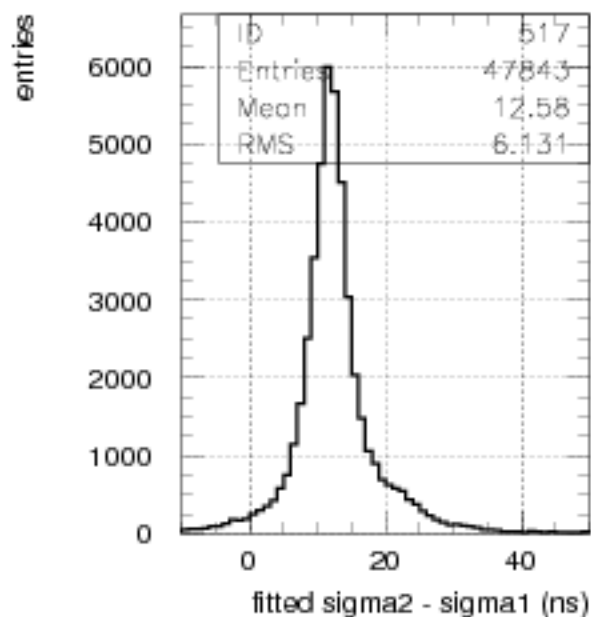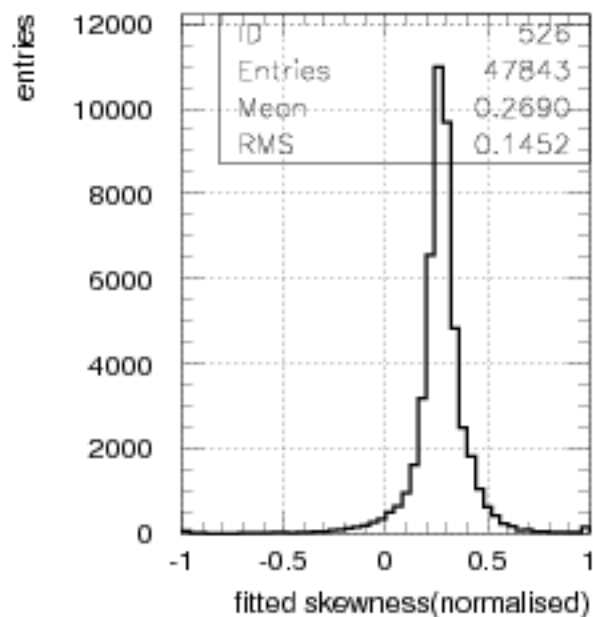


2025/10/05 18.19

The variability of MUV1 pulses: RMS(histogram) vs fitted amplitude

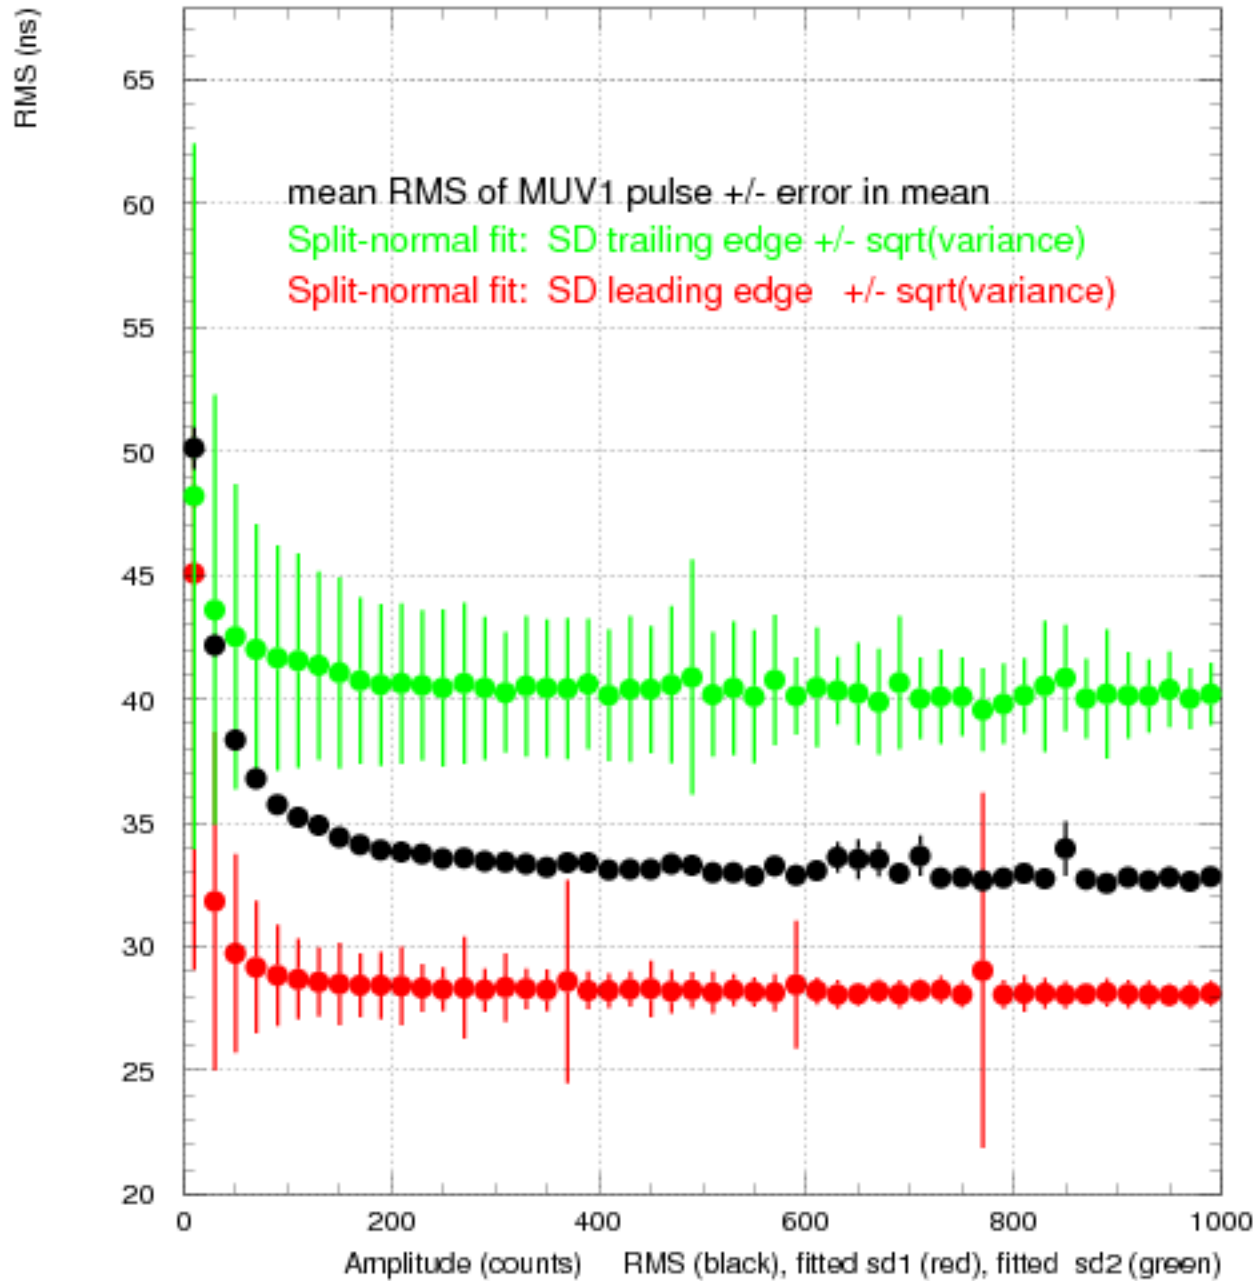

2025/10/05 18.19

(size of pulse)/amplitude vs amplitude

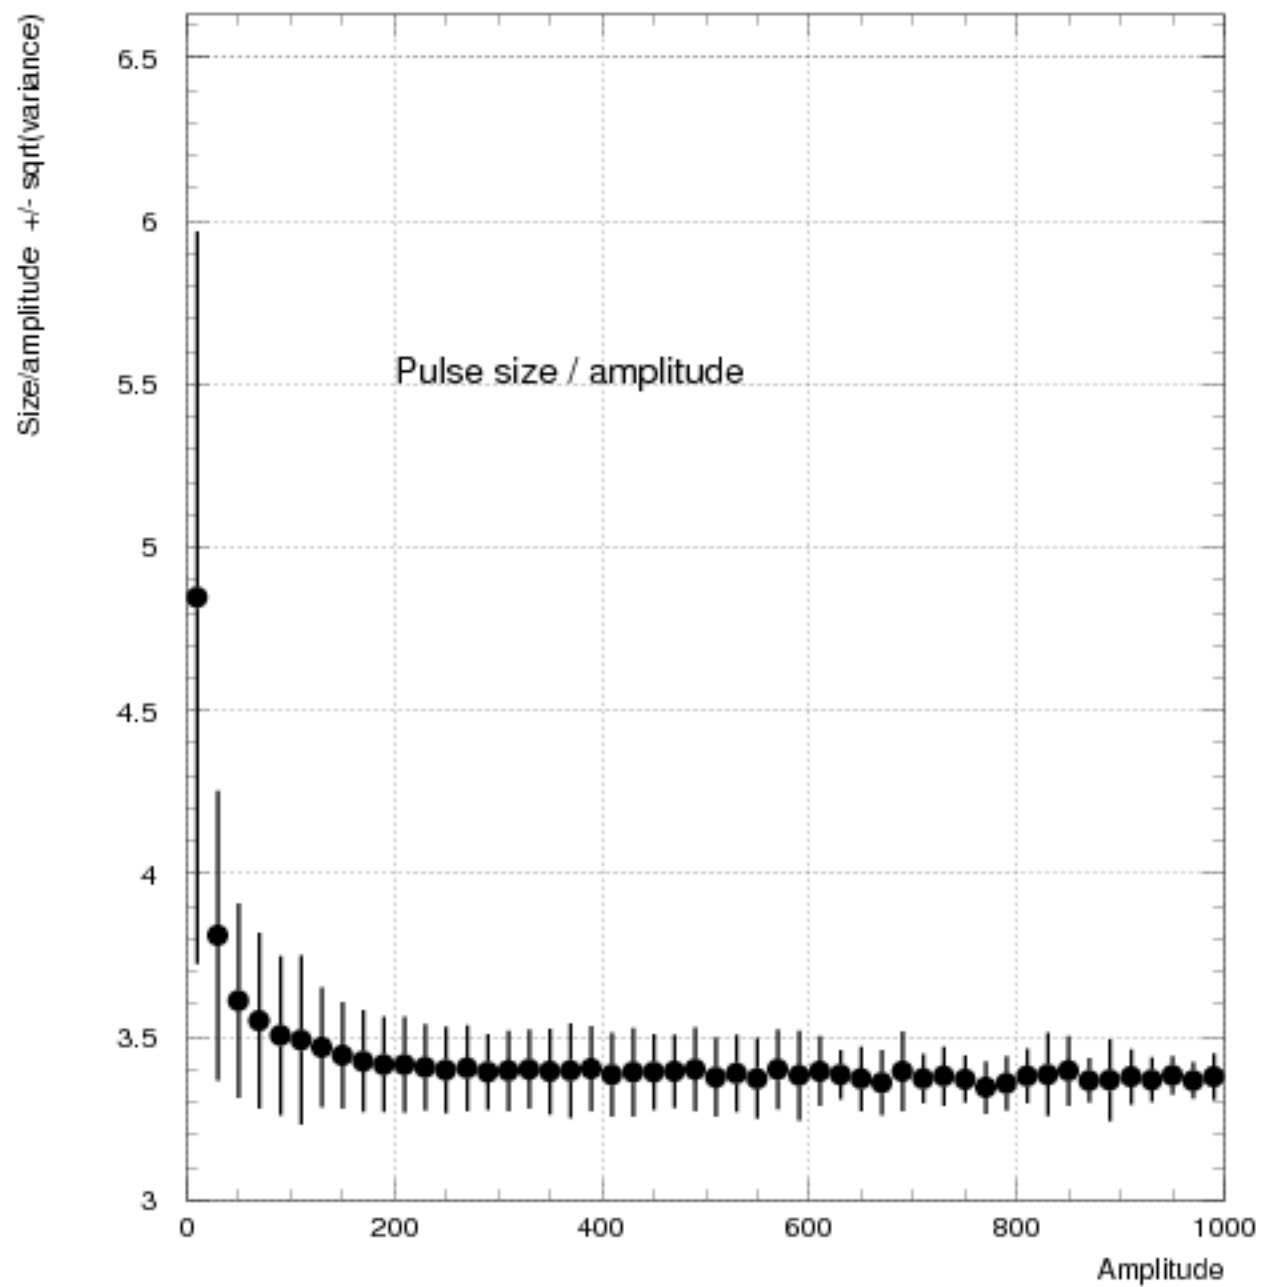

2025/10/05 18.19

(sd2 - sd1) vs amplitude

