

Fig. 1 Spill plots for triggers RUN 12288

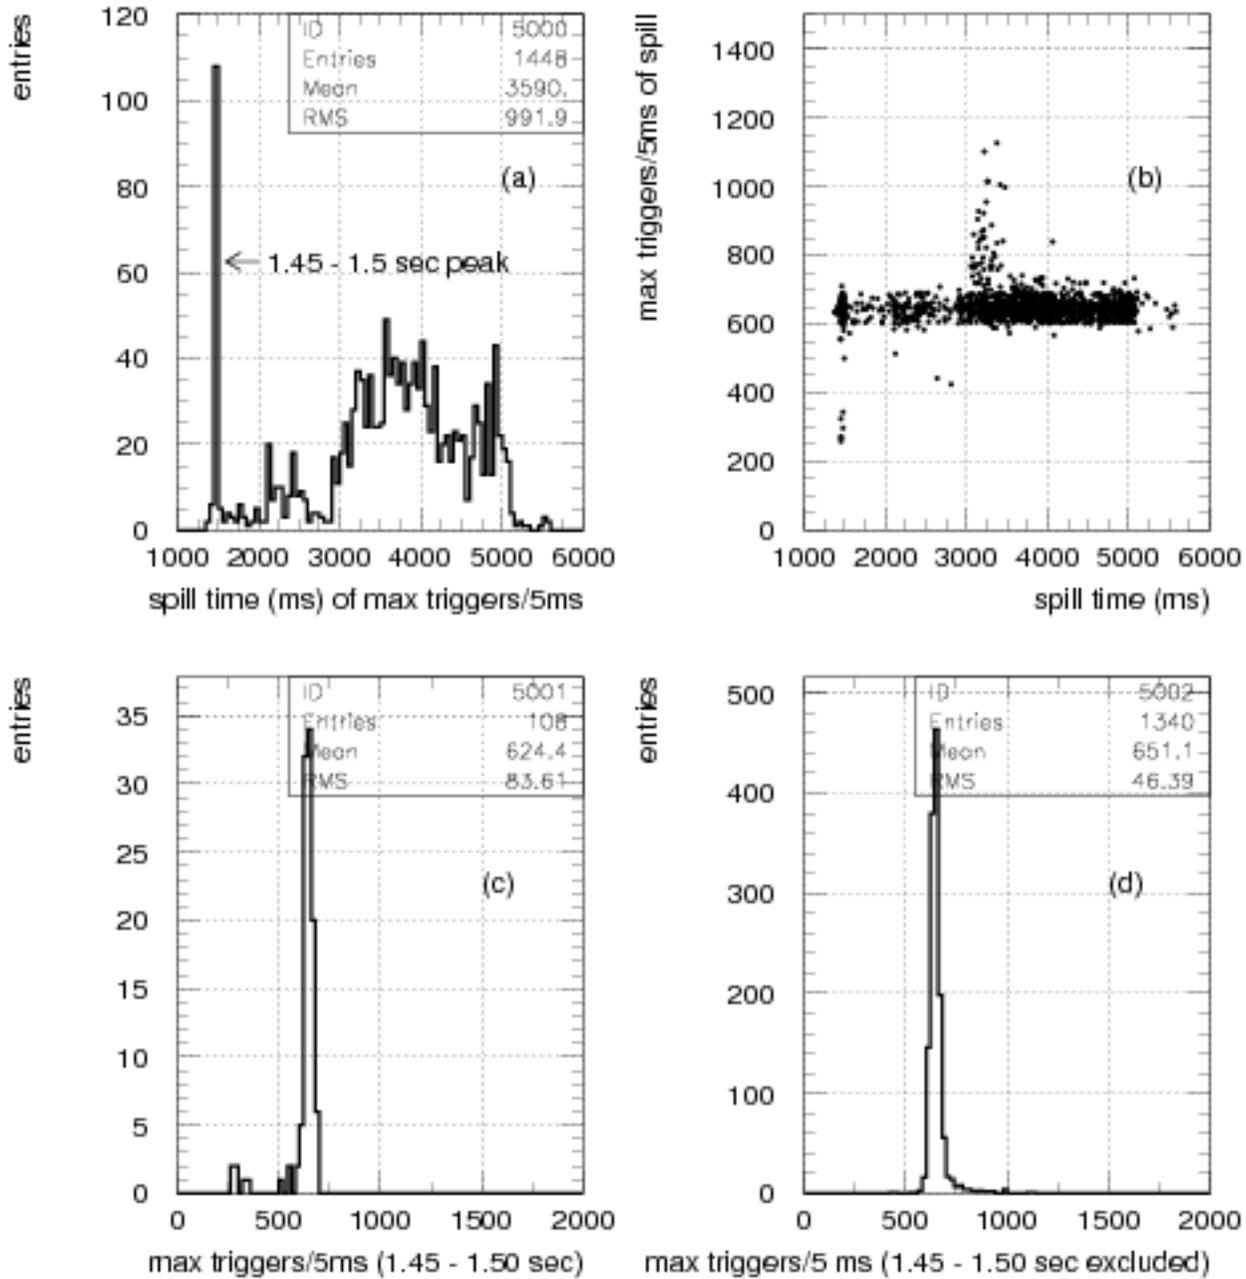


Fig. 2 Spill plots for triggers


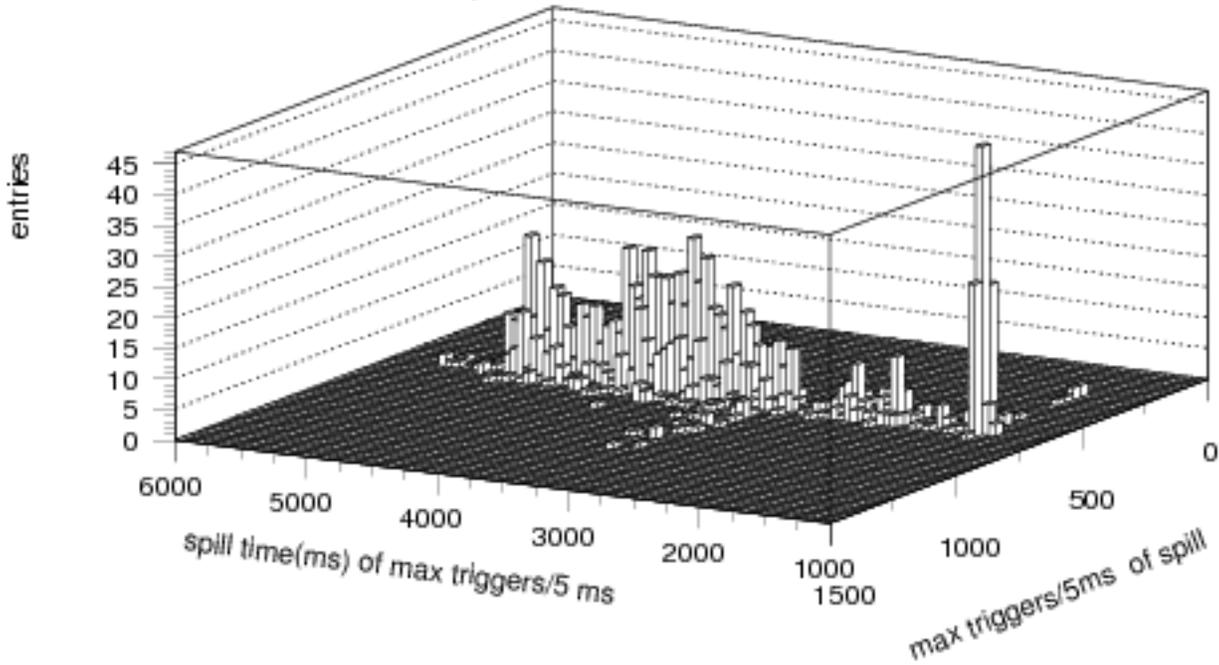


Fig. 3 Spill plots for triggers (spill 1.45 - 1.5 sec selected)

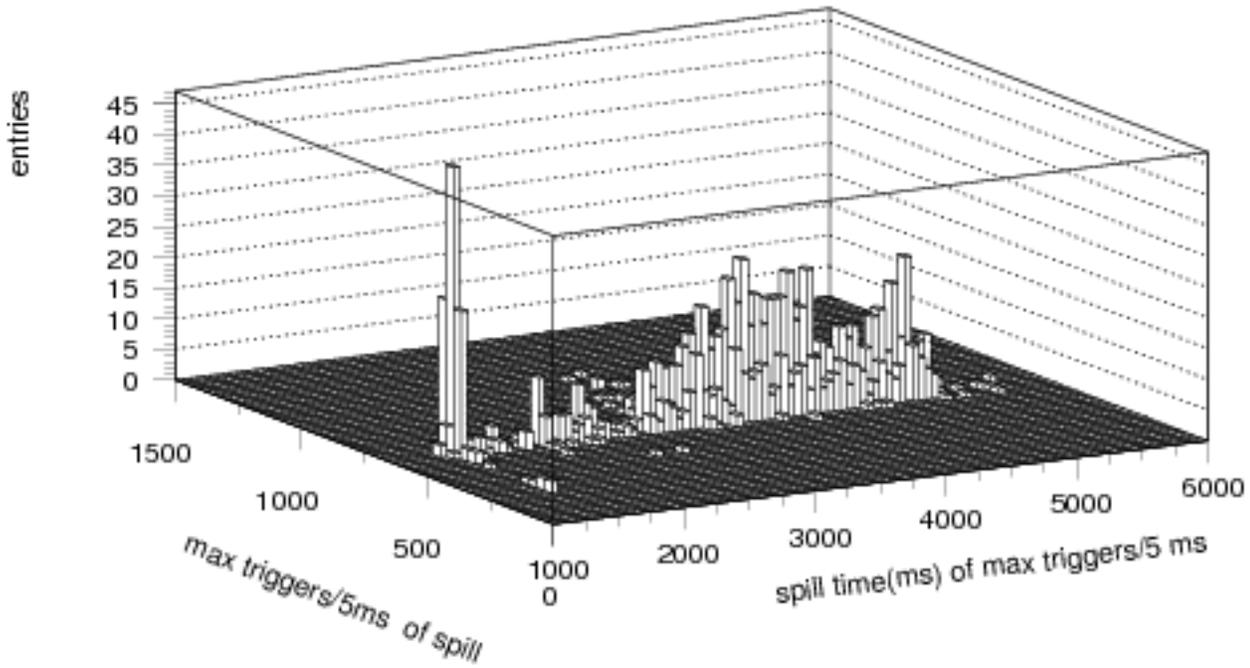